

# Column & Fire Equipment Guidelines


**Booth 17730**  
**Room 261A**

Please be aware of building support columns with fire equipment in or around your booth space.

General booth guidelines can be found here:

<https://www.namm.org/exhibit/thenammshow/important-guidelines/display-guidelines-rules-regulations>

NOTE: Fire equipment must be visible and accessible at all times

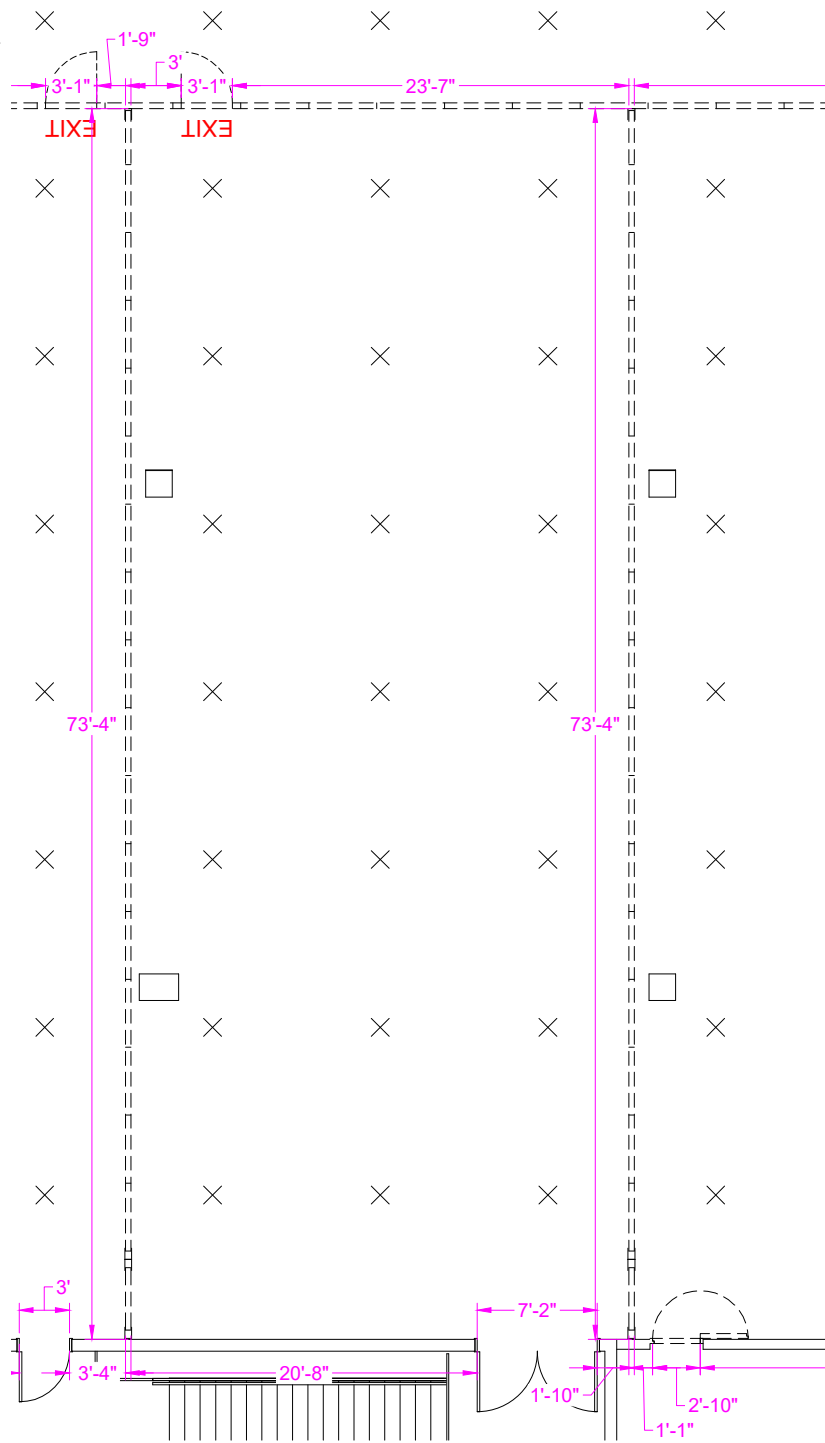


## REFERENCE GUIDELINES (unless otherwise noted on map)

**FS (Fire Strobe):** ACC exhibit hall are 20' height; ACC lobbies are 6'7" height from the floor.

**FE (Fire Extinguisher):** Must remain visible, accessible and unobstructed

**SP (Fire Speaker):** 6"x6" & located at 9'9" height from the floor and shall be visible and unobstructed

**FHC (Fire Hose Connection):** Must remain visible, accessible and unobstructed **FDR (Facility Door Release):** Must not be blocked

 Building Support Column

Exhibitors are free to brand & build around columns, as long as fire equipment is clear and nothing is adhered to the column or physical building.

  Utility Floor Ports

 Ceiling Rigging

## PLEASE NOTE:

- This diagram indicates the size and approximate position of the obstruction within the booth with measurements. This may vary slightly onsite once the floor has been marked
- All fire equipment on columns must remain visible and accessible at all times and fire hoses must be clear to the aisle.
- Fire alarm devices have a strobe and a speaker at two different heights on a column
- Materials may not be affixed to columns; damage will be billed back to the exhibitor by the Anaheim Convention Center.